


Communication Options for PowerPlus

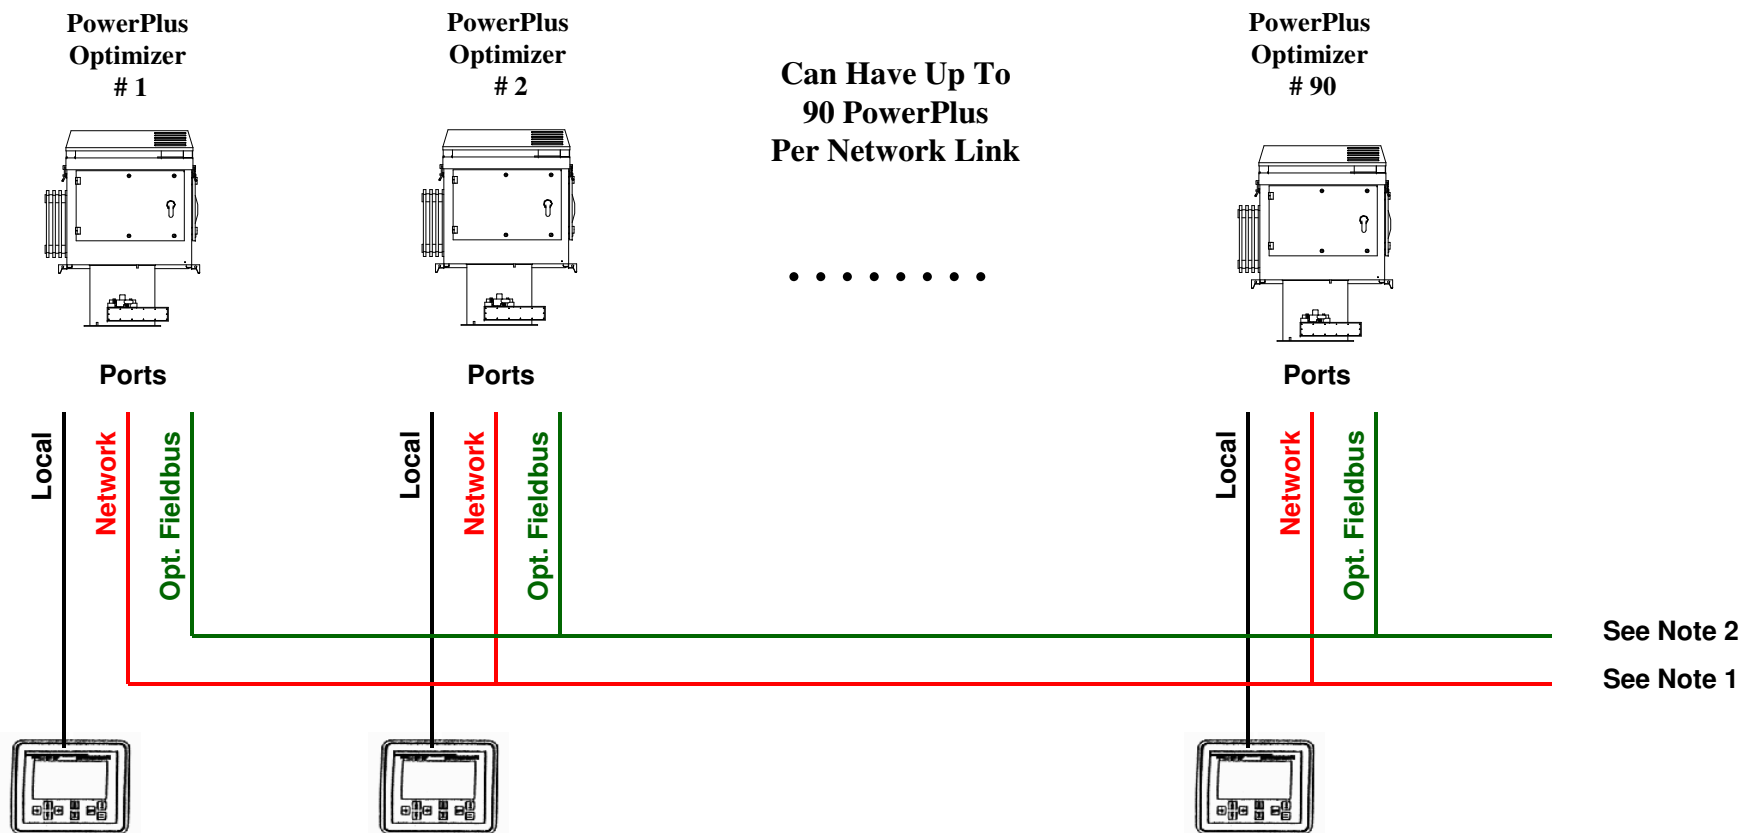

Note 1 – Network port can be user configured for NWL protocol for communications with NWL network displays (up to 4), PCAMS, and/or DCSi, or it can be configured for Modbus RTU protocol for communications with a PLC or other device.

Note 2 – Optional Fieldbus connection. Available Modules: Modbus TCP, Modbus Plus, Modbus RTU, Profibus, Profinet, Ethernet IP, CANopen, DeviceNet, and ControlNet. Interconnection will be dependant upon desired fieldbus.

Note 3 – Local port uses NWL protocol only for connection to a single keypad/display for communicating to a single unit.